

Approval body for construction products and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-13/1038

of 8 December 2016

English translation prepared by DIBt - Original version in German language

General Part

| | |
|--|---|
| Technical Assessment Body issuing the European Technical Assessment: | Deutsches Institut für Bautechnik |
| Trade name of the construction product | Hilti screw anchor HUS3 |
| Product family to which the construction product belongs | Concrete screw for use in concrete |
| Manufacturer | Hilti Aktiengesellschaft 9494 SCHAAN FÜRSTENTUM LIECHTENSTEIN |
| Manufacturing plant | Hilti Werke |
| This European Technical Assessment contains | 27 pages including 3 annexes |
| This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of | Guideline for European technical approval of "Metal anchors for use in concrete", ETAG 001 Part 3: "Undercut anchors", April 2013, used as European Assessment Document (EAD) according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011 and European Assessment Document (EAD) 330011-00-0601 "Assessment of adjustable concrete screws" |
| This version replaces | ETA-13/1038 issued on 10 May 2016 |

European Technical Assessment

ETA-13/1038

English translation prepared by DIBt

Page 2 of 27 | 8 December 2016

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific Part**1 Technical description of the product**

The Hilti screw anchor HUS3 is an anchor made of galvanised steel (HUS3-H, HUS3-HF, HUS3-C, HUS3-P, HUS3-PS, HUS3-A, HUS3-I, HUS3-I Flex) of sizes 6, 8, 10 and 14. The anchor is screwed into a predrilled cylindrical drill hole. The special thread of the anchor cuts an internal thread into the member while setting. The anchorage is characterised by mechanical interlock in the special thread.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment**3.1 Mechanical resistance and stability (BWR 1)**

| Essential characteristic | Performance |
|--|--------------------|
| Characteristic resistance under static and quasi-static loading | See Annex C1 – C3 |
| Characteristic resistance under seismic performance Category C1 and C2 | See Annex C4 – C5 |
| Displacements for tension and shear loads | See Annex C9 – C10 |

3.2 Safety in case of fire (BWR 2)

| Essential characteristic | Performance |
|--------------------------|---|
| Reaction to fire | Anchorage satisfies requirements for Class A1 |
| Resistance to fire | See Annex C6 – C8 |

3.3 Safety in use (BWR 4)

The essential characteristics regarding Safety in use are included under the Basic Works Requirement Mechanical resistance and stability.

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with guideline for European technical approval ETAG 001, April 2013, used as European Assessment Document (EAD) according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011, and European Assessment Document EAD 330011-00-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document


Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 8 December 2016 by Deutsches Institut für Bautechnik

Andreas Kummerow
p. p. Head of Department


beglaubigt:
Lange

Product and installed condition without adjustment

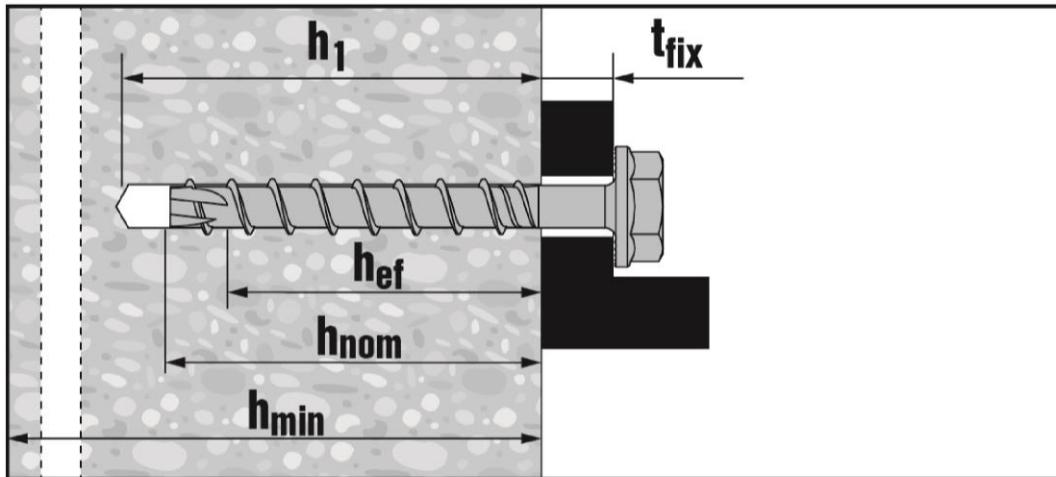

HUS3-H (hexagon head configuration sizes 6, 8, 10 and 14)

HUS3-HF (hexagon head configuration sizes 8, 10 and 14)

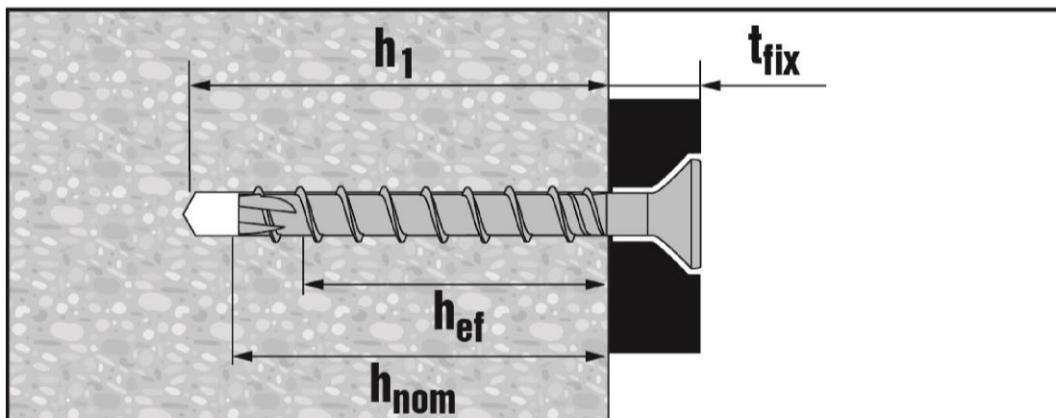

HUS3-C (countersunk head configuration sizes 6, 8 and 10)


Hilti Screw anchor HUS3

Product description


Installed condition without adjustment

Annex A1


Product and installed condition without adjustment

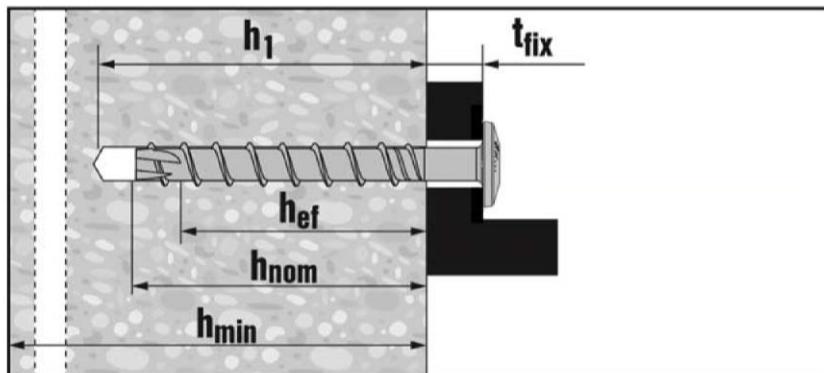

HUS3-P/PS (pan head configuration size 6)

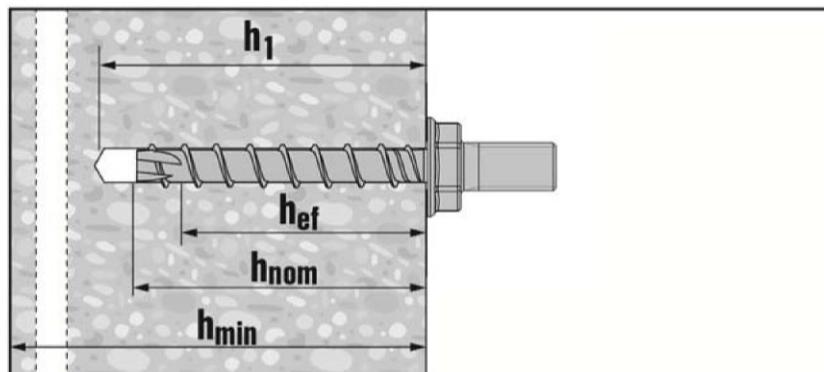

HUS3-A (size 6 with external thread configuration M8 or M10)

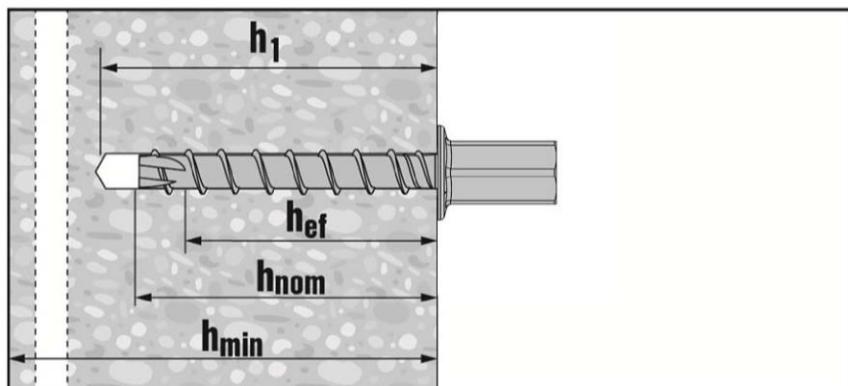

HUS3-I (size 6 with internal thread configuration M8/M10)


Hilti Screw anchor HUS3

Product description

Installed condition without adjustment


Annex A2

Product and installed condition with adjustment

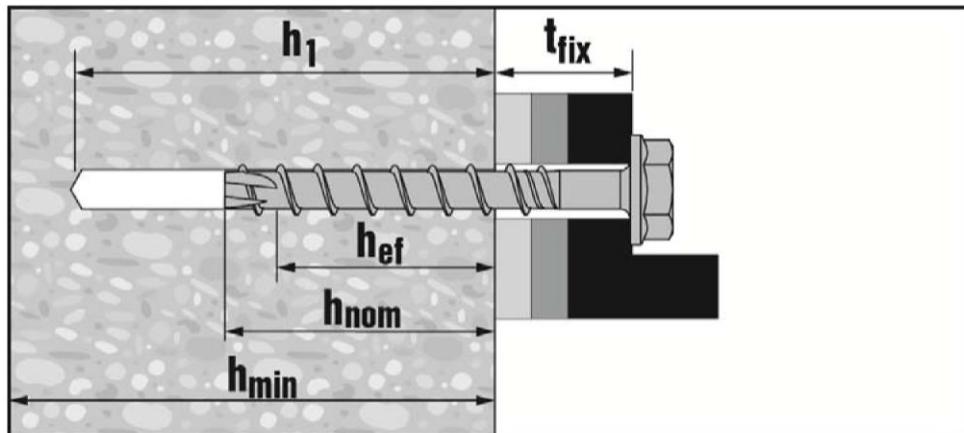

HUS3-H (hexagon head configuration sizes 8, 10 – $h_{\text{nom}2}, h_{\text{nom}3}$)

HUS3-HF (hexagon head configuration sizes 8 and 10 – $h_{\text{nom}2}, h_{\text{nom}3}$)

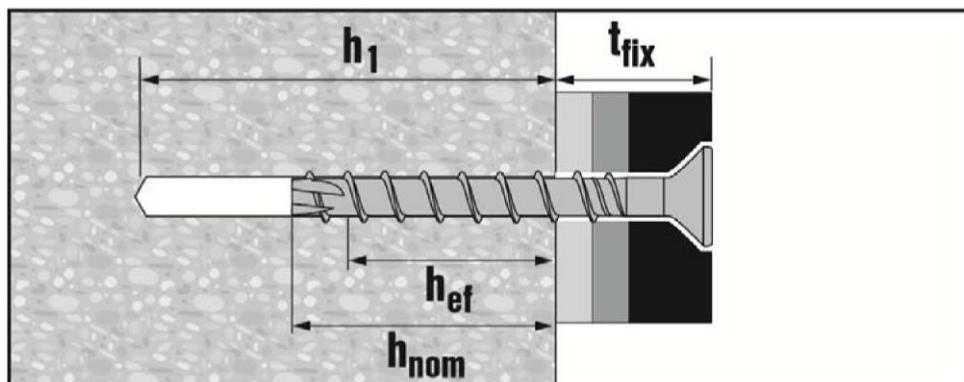

HUS3-C (countersunk head configuration sizes 8 and 10 – $h_{\text{nom}2}, h_{\text{nom}3}$)






Hilti Screw anchor HUS3

Product description

Installed condition with adjustment

Annex A3

Table A1: Material and screw types
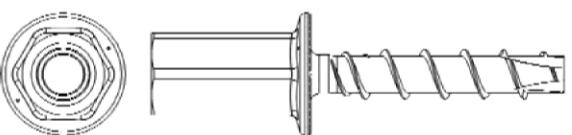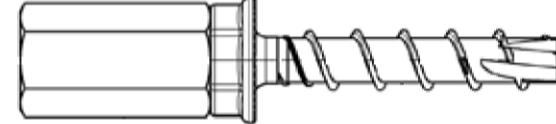
| Part | Designation / Material | | | | | |
|-------|--|----------|----------------------|-----|-----|-----|
| 1, 2, | Screw anchor / Carbon steel | | | | | |
| 3, 4, | Anchor size HUS3 | | | | | |
| 5, 6, | Characteristic yield strength | f_{yk} | [N/mm ²] | 6 | 8 | 10 |
| 7. | Characteristic ultimate strength | f_{uk} | [N/mm ²] | 745 | 695 | 690 |
| | Elongation at rupture | A_s | [%] | | | 630 |
| | | | | 930 | 810 | 805 |
| | | | | | ≤8 | 730 |
| | | | | | | |
| |  1) Hilti HUS3-H, sizes 6, 8, 10 and 14, hexagonal head configuration, galvanized | | | | | |
| |  2) Hilti HUS3-HF, sizes 8, 10 and 14, hexagonal head configuration, multilayer coating | | | | | |
| |  3) Hilti HUS3-C, sizes 6, 8 and 10, countersunk head configuration, galvanized | | | | | |
| |  4) Hilti HUS3-A, size 6, external thread M8/16 and M10/21, galvanized | | | | | |
| |  5) Hilti HUS3-P, size 6, pan head configuration, galvanized | | | | | |
| |  6) Hilti HUS3-PS, size 6, pan head (small) configuration, galvanized | | | | | |
| |  7) Hilti HUS3-I, size 6, internal thread M8 and M10, galvanized | | | | | |
| |  8) Hilti HUS3-I Flex, size 6, galvanized, with external thread - M8/16 preassembled with coupler M6 or M8, - M10/21 preassembled with coupler M10 or M12. | | | | | |

Hilti Screw anchor HUS3


Production description

Material and screw types

Annex A4

Table A2: Specification and marking


| Anchor size HUS3 | | | 6 H, C, A, P, PS, I, I-Flex | 8 H, HF, C | | | 10 H, HF, C | | | 14 H, HF | | | H |
|----------------------------|-------|--------------------|-----------------------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|---|
| | | | h_{nom} | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | |
| Nominal embedding depth | [mm] | | 55 | 50 | 60 | 70 | 55 | 75 | 85 | 65 | 85 | 115 | |
| Threaded outer diameter | d_t | [mm] | 7,85 | 10,30 | | | 12,40 | | | 16,85 | | | |
| Core diameter | d_k | [mm] | 5,85 | 7,85 | | | 9,90 | | | 12,95 | | | |
| Shaft diameter | d_s | [mm] | 6,15 | 8,45 | | | 10,55 | | | 13,80 | | | |
| Stressed section | A_s | [mm ²] | 26,9 | 48,4 | | | 77,0 | | | 131,7 | | | |

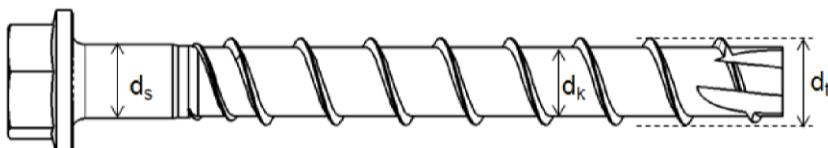

HUS3 : Hilti Universal Screw 3rd generation

H : Hexagonal head

10 : screw diameter



45/25/15 : maximum thickness fixture $t_{\text{fix}1}/t_{\text{fix}2}/t_{\text{fix}3}$ related to the embedment depth $h_{\text{nom}1}/h_{\text{nom}2}/h_{\text{nom}3}$ (see Annex B4 and B5)

Hilti Screw anchor HUS3

Production description

Material and screw types

Annex A5

Specifications of intended use

Anchors subject to:

- Static and quasi-static loads: All sizes and all embedment depths.
- Seismic action for Performance Category C1:
 - HUS3-H sizes 8, 10 and 14, standard and maximum embedment depth (h_{nom2} and h_{nom3}).
 - HUS3-C and HUS3-HF sizes 8 and 10, standard and maximum embedment depth (h_{nom2} and h_{nom3}).
- Seismic action for Performance Category C2:
 - HUS3-H and HUS-HF size 10, HUS3-H size 14, maximum embedment depth h_{nom3} .
 - HUS3-C size 10, maximum embedment depth h_{nom3} .
- Fire exposure: All sizes and all embedment depths.

Base materials:

- Reinforced or unreinforced normal weight concrete according to EN 206-1:2000,
- Strength classes C20/25 to C50/60 according to EN 206-1:2000,
- Non-cracked or cracked concrete: all sizes and all embedment depths.

Use conditions (Environmental conditions):

- Anchorages subject to dry internal conditions.

Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e.g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages under static or quasi-static actions are designed in accordance with:
 - ETAG 001, Annex C, design method A, Edition August 2010 or
 - CEN/TS 1992-4:2009, design method A
- Anchorages under seismic actions (cracked concrete) are designed in accordance with:
 - EOTA Technical Report TR 045, Edition February 2013
 - Anchorages shall be positioned outside of critical regions (e.g. plastic hinges) of the concrete structure
 - Fastenings in stand-off installation or with a grout layer are not allowed
- Anchorages under fire exposure are designed in accordance with:
 - ETAG 001, Annex C, design method A, Edition August 2010 and EOTA Technical Report TR 020, Edition May 2004 or
 - CEN/TS 1992-4: 2009, Annex D
 - It must be ensured that local spalling of the concrete cover does not occur.

Hilti Screw anchor HUS3

Intended Use
Specifications

Annex B1

Specifications of intended use

Installation:

- Hammer drilling only: all sizes and all embedment depths.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted hole is filled with high strength mortar and if under shear or oblique tension load it is not the direction of the load application.
- After installation further turning of the anchor must not be possible.
- The head of the anchor must be supported on the fixture and is not damaged.
- Adjustability according to Annex B8 for:
 - HUS3-H, HUS3-HF and HUS3-C size 8 ($h_{nom2} = 60$ mm and $h_{nom3}=70$ mm)
 - HUS3-H, HUS3-HF and HUS3-C size 10 ($h_{nom2} = 75$ mm and $h_{nom3}=85$ mm)
- Installation with Hilti filling set (HUS3-H only) according to Annex B7.

Hilti Screw anchor HUS3

Intended Use
Specifications

Annex B2

Table B1: Installation parameters HUS3-6

| Anchor size HUS3 | | | 6 | | | | |
|--|-------------------|----------------------|--|------|----|--------|----|
| Type | H | C | A | P-PS | I | I-Flex | |
| Nominal embedment depth | [mm] | 55 | | | | | |
| Nominal drill hole diameter | d_0 | [mm] | 6 | | | | |
| Cutting diameter of drill bit | $d_{cut} \leq$ | [mm] | 6,40 | | | | |
| Clearance hole diameter | $d_f \leq$ | [mm] | 9 | | | | |
| Wrench size (H, A, I-type) | SW | [mm] | 13 | - | 13 | - | 13 |
| Countersunk head diameter | d_h | [mm] | - | 11,5 | - | | |
| Torx size (C, P, PS -type) | TX | - | - | 30 | - | 30 | - |
| Depth of drill hole in floor/ wall position | $h_1 \geq$ | [mm] | 65 | | | | |
| Depth of drill hole in ceiling position | $h_1 \geq$ | [mm] | 58 | | | | |
| Installation Torque | T_{inst} | [Nm] | 25 | | | | |
| Setting tool ¹⁾ | Strength class | C20/25 and >20/25 | Hilti SIW 14 A or Hilti SIW 22 A or | | | | |

Table B2: Installation parameters HUS3-8, 10 and 14

| Anchor size HUS3 | | | 8 | | | 10 | | | 14 | | |
|---|-------------------|------------------------|--|------------|------------|---------------------------------------|------------|------------|------------------|------------|------------|
| Type | | | H, HF, C | | | H, HF, C | | | H, HF | | H |
| Nominal embedment depth | h_{nom} | [mm] | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} |
| | | | 50 | 60 | 70 | 55 | 75 | 85 | 65 | 85 | 115 |
| Nominal drill hole diameter | d_0 | [mm] | 8 | | | 10 | | | 14 | | |
| Cutting diameter of drill bit | $d_{cut} \leq$ | [mm] | 8,45 | | | 10,45 | | | 14,50 | | |
| Clearance hole diameter | $d_f \leq$ | [mm] | 12 | | | 14 | | | 18 | | |
| Wrench size (H, HF-type) | SW | [mm] | 13 | | | 15 | | | 21 | | |
| Diameter of countersunk head | d_h | [mm] | 18 | | | 21 | | | - | | |
| Torx size (C-type) | TX | - | 45 | | | 50 | | | - | | |
| Depth of drill hole | $h_1 \geq$ | [mm] | 60 | 70 | 80 | 65 | 85 | 95 | 75 | 95 | 125 |
| Depth of drill hole (with adjustability setting process) | $h_1 \geq$ | [mm] | - | 80 | 90 | - | 95 | 105 | - | | |
| Setting tool ¹⁾ | Strength class | C20/25 > C20/25 | Hilti SIW 14 A or Hilti SIW 22 A or Hilti SIW 22 T-A | | | Hilti SIW 22 A or Hilti SIW 22 T-A | | | Hilti SIW 22 T-A | | |

¹⁾ Installation with other impact screw driver of equivalent power is possible

Hilti Screw anchor HUS3

Intended Use
Installation parameter



Annex B3

Table B3: Minimum thickness of concrete member, minimum edge distance and spacing HUS3-6

| Anchor size HUS3 | | | 6 |
|--------------------------------------|-----------------------|------------------|-----|
| Nominal embedment depth | h_{nom} | [mm] | 55 |
| Minimum thickness of concrete member | h_{min} | [mm] | 100 |
| Cracked and non-cracked concrete | Minimum spacing | s_{min} | 35 |
| Cracked and non-cracked concrete | Minimum edge distance | c_{min} | 35 |

Table B4: Minimum thickness of concrete member, minimum edge distance and spacing HUS3-8, 10 und 14

| Anchor size HUS3 | | | 8 | | | 10 | | | 14 | | |
|--------------------------------------|-----------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-----|-----|
| | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | | |
| Nominal embedment depth | h_{nom} | [mm] | 50 | 60 | 70 | 55 | 75 | 85 | 65 | 85 | 115 |
| Minimum thickness of concrete member | h_{min} | [mm] | 100 | 100 | 120 | 100 | 130 | 140 | 120 | 160 | 200 |
| Cracked and non-cracked concrete | Minimum spacing | s_{min} | 40 | 50 | 50 | 50 | 50 | 60 | 60 | 75 | 75 |
| Cracked and non-cracked concrete | Minimum edge distance | c_{min} | 50 | 50 | 50 | 50 | 50 | 60 | 60 | 75 | 75 |

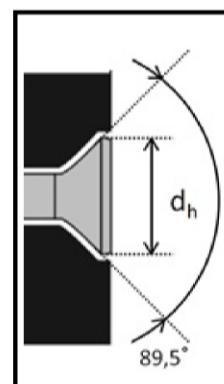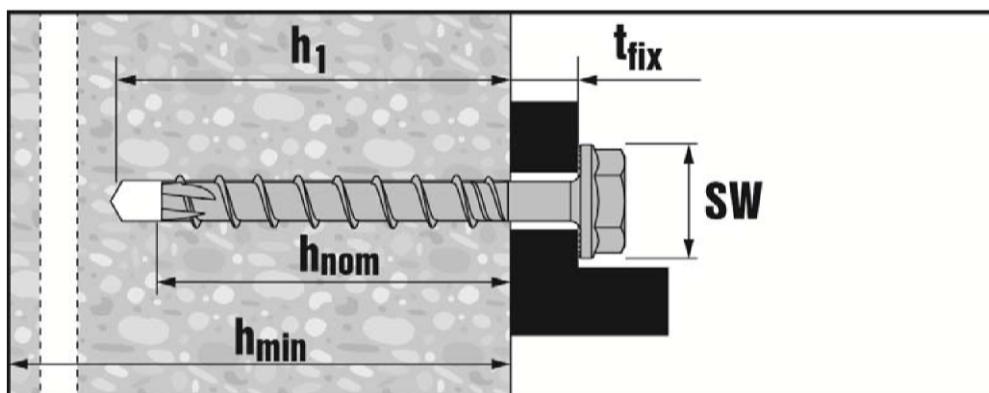

Hilti Screw anchor HUS3

Intended Use

Minimum thickness and minimum edge distance and spacing


Annex B4

Table B5: Screw length and maximum thickness of fixture for HUS3-6

| Anchor size | 6 | | | | | |
|----------------------|---------------------------|----|-----|---|----|----|
| | H | C | A | I | P | PS |
| embedment depth [mm] | 55 | | | | | |
| Length of screw [mm] | Thickness of fixture [mm] | | | | | |
| 55 | | | 0 | 0 | | |
| 60 | 5 | 5 | | | 5 | 5 |
| 70 | | 15 | | | | |
| 80 | 25 | | | | 25 | |
| 100 | 45 | | | | | |
| 120 | 65 | | | | | |
| 135 | | | 80 | | | |
| 155 | | | 100 | | | |
| 175 | | | 120 | | | |
| 195 | | | 140 | | | |

Table B6: Screw length and maximum thickness of fixture for HUS3-C 8 and 10

| Anchor size | 8 | | | 10 | | |
|------------------------------|---------------------------|------------------|------------------|------------------|------------------|------------------|
| | h_{nom1} 50 | h_{nom2} 60 | h_{nom3} 70 | h_{nom1} 55 | h_{nom2} 75 | h_{nom3} 85 |
| Nominal embedment depth [mm] | Thickness of fixture [mm] | | | | | |
| Length of screw [mm] | t_{fix1} | t_{fix2} | t_{fix3} | t_{fix1} | t_{fix2} | t_{fix3} |
| 65 | 15 | 5 | - | - | - | - |
| 70 | - | - | - | 15 | - | - |
| 75 | 25 | 15 | - | - | - | - |
| 85 | 35 | 25 | 15 | - | - | - |
| 90 | - | - | - | 35 | 15 | - |
| 100 | - | - | - | 45 | 25 | 15 |

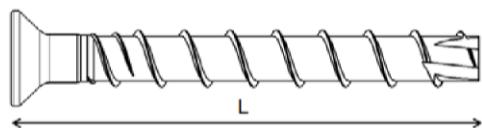

Hilti Screw anchor HUS3

Intended Use


Screw Length / thickness of fixture

Annex B5

Table B7: Screw length and maximum thickness of fixture for HUS3-H and HUS3-HF¹⁾

| Anchor size | 8 | | | 10 | | | 14 | | |
|------------------------------|---------------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|--------------------------|
| | $h_{\text{nom}1}$ 50 | $h_{\text{nom}2}$ 60 | $h_{\text{nom}3}$ 70 | $h_{\text{nom}1}$ 55 | $h_{\text{nom}2}$ 75 | $h_{\text{nom}3}$ 85 | $h_{\text{nom}1}$ 65 | $h_{\text{nom}2}$ 85 | $h_{\text{nom}3}$ 115 |
| Nominal embedment depth [mm] | Thickness of fixture [mm] | | | | | | | | |
| Length of screw [mm] | $t_{\text{fix}1}$ | $t_{\text{fix}2}$ | $t_{\text{fix}3}$ | $t_{\text{fix}1}$ | $t_{\text{fix}2}$ | $t_{\text{fix}3}$ | $t_{\text{fix}1}$ | $t_{\text{fix}2}$ | $t_{\text{fix}3}$ |
| 55 | 5 | - | - | - | - | - | - | - | - |
| 60 | - | - | - | 5 | - | - | - | - | - |
| 65 | 15 | 5 | - | - | - | - | - | - | - |
| 70 | - | - | - | 15 | - | - | - | - | - |
| 75 | 25 | 15 | 5 | - | - | - | 10 | - | - |
| 80 | - | - | - | 25 | 5 | - | - | - | - |
| 85 | 35 | 25 | 15 | - | - | - | - | - | - |
| 90 | - | - | - | 35 | 15 | 5 | - | - | - |
| 100 | 50 | 40 | 30 | 45 | 25 | 15 | 35 | 15 | - |
| 110 | - | - | - | 55 | 35 | 25 | - | - | - |
| 120 | 70 | 60 | 50 | - | - | - | - | - | - |
| 130 | - | - | - | 75 | 55 | 45 | 65 | 45 | 15 |
| 150 | 100 | 90 | 80 | 95 | 75 | 65 | 85 | 65 | 35 |

1) HUS3-HF available for size 14 with h_1 and h_2 only

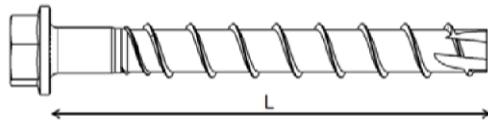

Hilti Screw anchor HUS3


Intended Use

Screw Length / thickness of fixture

Annex B6


Installation instruction without adjustment

1

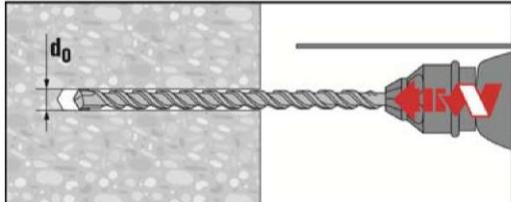


Make a cylindrical hole

2

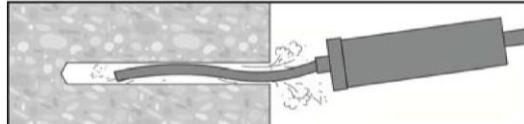


Clean the borehole

3

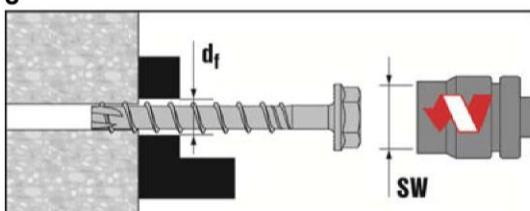






Install the screw anchor by impact screw driver (sizes 6, 8, 10 and 14)-or by torque wrench (size 6)

4

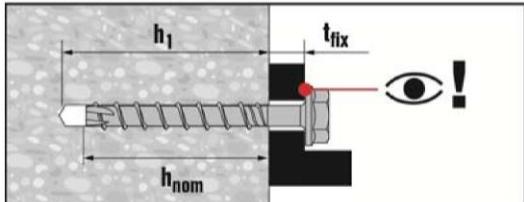

Ensure that the head of the anchor is fully supported on the fixture and it is not damaged.

Installation instruction with Hilti seismic filling set (HUS3-H only)

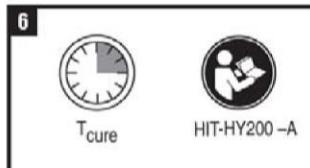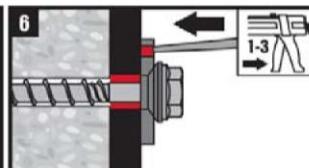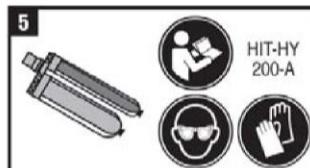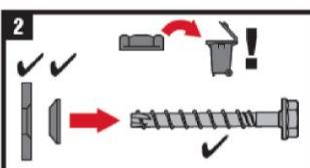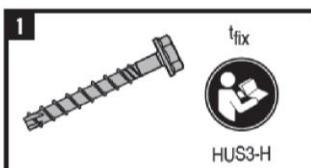

| Size Seismic Set | Size HUS3 | t _{fix, effective} (mm) |
|------------------|-----------|----------------------------------|
| M10 | 8 | t _{fix} - 7 mm |
| M12 | 10 | t _{fix} - 8 mm |
| M16 | 14 | t _{fix} - 9 mm |










Hilti Screw anchor HUS3

Intended Use

Installation Instruction without adjustment
Installation with Hilti seismic filling set

Annex B7

Installation instruction with adjustment

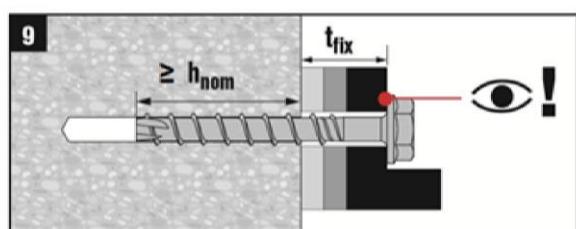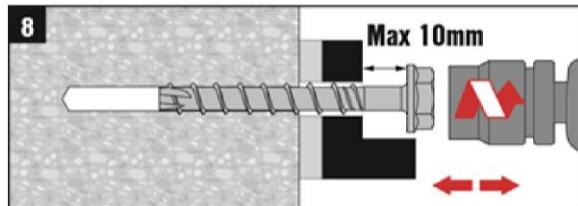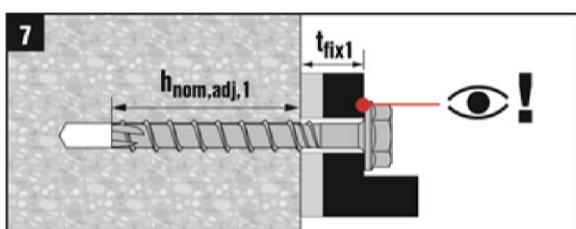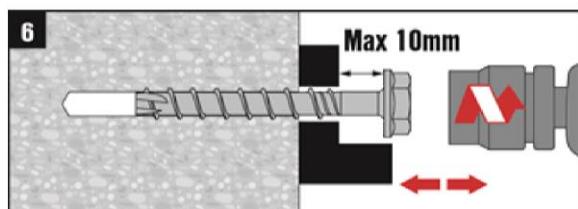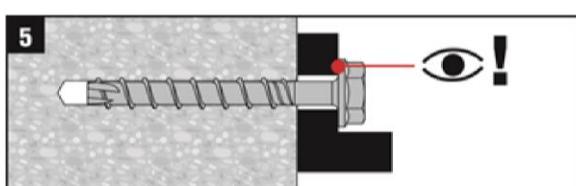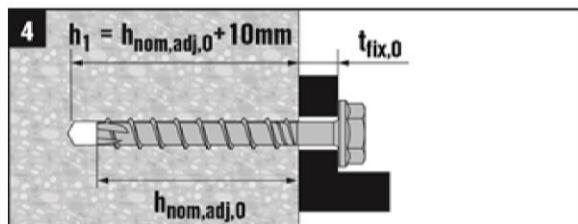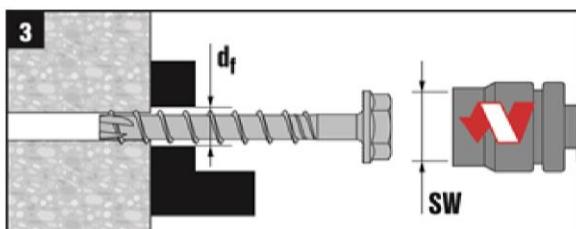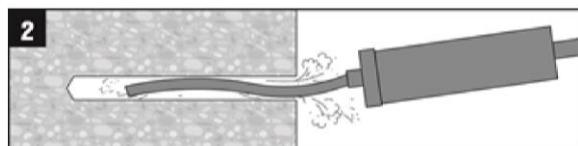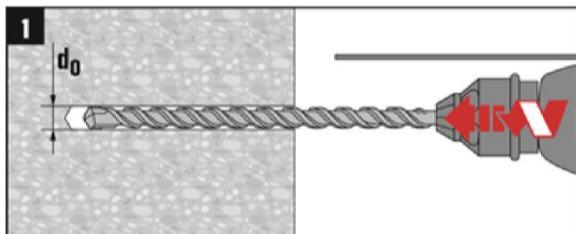

The anchor can be adjusted maximum two times.

The total allowed thickness of shims added during the adjustment process is 10mm.

The final embedment depth after adjustment process must be larger or equal than $h_{\text{nom}2}$ or $h_{\text{nom}3}$.

Hilti Screw anchor HUS3

Intended Use

Installation instruction with adjustment

Annex B8

Table C1: Characteristic values for static and quasi-static action HUS3-6

| Anchor size HUS3 | | Type | H | C | A | I | 6 I-Flex | P | PS |
|--|--------------------------------------|-----------------------|-----|----|---------------------|------|-------------|----|----|
| Nominal embedment depth | | h_{nom} [mm] | | | | 55 | | | |
| Steel failure for tension and shear load | | | | | | | | | |
| Characteristic resistance | $N_{Rk,s}$ | [kN] | 24 | 22 | | 24 | | 21 | |
| Partial safety factor | $\gamma_{Ms,N}$ | [-] | | | | 1,4 | | | |
| Characteristic resistance | $V_{Rk,s}$ | [kN] | | | | 12,5 | | | |
| Partial safety factor | $\gamma_{Ms,V}$ | [-] | | | | 1,5 | | | |
| k_2 factor | $k_2^{1)}$ | [-] | | | | 0,8 | | | |
| Characteristic resistance | $M_{Rk,s}^0$ | [Nm] | | | | 21 | | | |
| Pull-out failure | | | | | | | | | |
| Characteristic resistance in non-cracked concrete C20/25 | $N_{Rk,p}$ | [kN] | | | 9 | | 7,5 | | |
| Characteristic resistance in cracked concrete C20/25 | $N_{Rk,p}$ | [kN] | | | 6 | | | | |
| Increasing factor concrete | C30/37 | Ψ_c | [-] | | | 1,22 | | | |
| | C40/50 | | | | | 1,41 | | | |
| | C50/60 | | | | | 1,55 | | | |
| Concrete cone and splitting failure | | | | | | | | | |
| Effective embedment depth | h_{ef} | [mm] | | | 42 | | | | |
| Factor for Cracked | $k_{cr}^{1)}$ | [-] | | | 7,2 | | | | |
| Non-cracked | $k_{ucr}^{1)}$ | [-] | | | 10,1 | | | | |
| Concrete cone failure | Edge distance | $c_{cr,N}$ [mm] | | | 1,5 h_{ef} | | | | |
| | Spacing | $s_{cr,N}$ [mm] | | | 3 h_{ef} | | | | |
| Splitting failure | Edge distance | $c_{cr,sp}$ [mm] | | | 63 | | | | |
| | Spacing | $s_{cr,sp}$ [mm] | | | 126 | | | | |
| Installation safety factor | $\gamma_2^{2)} = \gamma_{inst}^{1)}$ | [-] | | | 1,2 | | | | |
| Concrete pry-out failure | | | | | | | | | |
| k factor | $K^{2)} = k_3^{1)}$ | [-] | | | 1,5 | | | | |
| Concrete edge failure | | | | | | | | | |
| Effective length of anchor | $l_f = h_{\text{ef}}$ | [-] | | | 42 | | | | |
| Outside diameter of anchor | d_{nom} [mm] | | | | 6 | | | | |

¹⁾ Parameters relevant only for design according to CEN/TS 1992-4:2009

²⁾ Parameter relevant only for design according to ETAG001 Annex C

Hilti Screw anchor HUS3

Performances

Characteristic values for static and quasi-static action

Annex C1

Table C2: Characteristic values for static and quasi-static action HUS3-8, 10 and 14

| Anchor size HUS3 | | | 8 | | | 10 | | | 14 | | | | | | | | |
|--|--|-------------|-------------------|----------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|--|--|--|--|--|--|
| Nominal embedment depth | h_{nom} | [mm] | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | | | | | | |
| | | | 50 | 60 | 70 | 55 | 75 | 85 | 65 | 85 | 115 | | | | | | |
| Adjustment | | | | | | | | | | | | | | | | | |
| Total max. thickness of adjustment layers | t_{adj} | [mm] | - | 10 | 10 | - | 10 | 10 | - | - | - | | | | | | |
| Max. number of adjustments | n_a | [\cdot] | - | 2 | 2 | - | 2 | 2 | - | - | - | | | | | | |
| Steel failure for tension load | | | | | | | | | | | | | | | | | |
| Characteristic resistance | $N_{Rk,s}$ | [kN] | 39,2 | | | 62,2 | | | 96,6 | | | | | | | | |
| Partial safety factor | $\gamma_{Ms,N}$ | [\cdot] | 1,4 | | | | | | | | | | | | | | |
| Pull-out failure | | | | | | | | | | | | | | | | | |
| Characteristic resistance in non-cracked concrete C20/25 | $N_{Rk,p}$ | [kN] | 9 | 12 | 16 | 12 | 20 | ¹⁾ | ¹⁾ | ¹⁾ | ¹⁾ | | | | | | |
| Characteristic resistance in cracked concrete C20/25 | $N_{Rk,p}$ | [kN] | 6 | 9 | 12 | ¹⁾ | ¹⁾ | ¹⁾ | ¹⁾ | ¹⁾ | ¹⁾ | | | | | | |
| Increasing factor concrete | C30/37 C40/50 C50/60 | ψ_c | [\cdot] | 1,22 1,41 1,55 | | | | | | | | | | | | | |
| Concrete cone and splitting failure | | | | | | | | | | | | | | | | | |
| Effective embedment depth | h_{ef} | [mm] | 40 | 46,4 | 54,9 | 41,6 | 58,6 | 67,1 | 49,3 | 66,3 | 91,8 | | | | | | |
| Factor for Cracked | k_{cr} ²⁾ | [\cdot] | 7,2 | | | | | | | | | | | | | | |
| Non-cracked | k_{ucr} ²⁾ | [\cdot] | 10,1 | | | | | | | | | | | | | | |
| Concrete cone failure | Edge distance | $c_{cr,N}$ | [mm] | 1,5 h_{ef} | | | | | | | | | | | | | |
| | Spacing | $s_{cr,N}$ | [mm] | 3 h_{ef} | | | | | | | | | | | | | |
| Splitting failure | Edge distance | $c_{cr,sp}$ | [mm] | 60 | 70 | 85 | 65 | 90 | 110 | 85 | 100 | | | | | | |
| | Spacing | $s_{cr,sp}$ | [mm] | 120 | 140 | 170 | 130 | 180 | 220 | 170 | 200 | | | | | | |
| Installation safety factor | γ_2 ³⁾ = γ_{inst} ²⁾ | [\cdot] | 1,0 | | | | | | | | | | | | | | |

¹⁾ Pull-out failure is not decisive

²⁾ Parameters relevant only for design according to CEN/TS 1992-4:2009

³⁾ Parameter relevant only for design according to ETAG001 Annex C

Hilti Screw anchor HUS3

Performances

Characteristic values for static and quasi-static action

Annex C2

Table C2 continued

| Anchor size HUS3 | | | 8 | | | 10 | | | 14 | | |
|---|-----------------------|-------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|
| Nominal embedment depth | h_{nom} | [mm] | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ |
| Adjustment | | | | | | | | | | | |
| Total max. thickness of adjustment layers | t_{adj} | [mm] | - | 10 | 10 | - | 10 | 10 | - | - | - |
| Max. number of adjustments | n_a | [-] | - | 2 | 2 | - | 2 | 2 | - | - | - |
| Steel failure for shear load | | | | | | | | | | | |
| Characteristic resistance | $V_{Rk,s}$ | [kN] | 19 | 22 | 30 | 34 | 55 | 62 | | | |
| Partial safety factor | $\gamma_{Ms,V}$ | [-] | | | 1,5 | | | | | | |
| k_2 factor | k_2 ¹⁾ | [-] | | | 0,8 | | | | | | |
| Characteristic resistance | $M_{Rk,s}^0$ | [Nm] | 46 | | 92 | | 187 | | | | |
| Concrete pry-out failure | | | | | | | | | | | |
| k factor | $k^2) = k_3^{1)}$ | [-] | 1,0 | 2,0 | 1,0 | | 2,0 | | | | |
| Concrete edge failure | | | | | | | | | | | |
| Effective length of anchor | $l_f = h_{\text{ef}}$ | [-] | 40 | 46,4 | 54,9 | 41,6 | 58,6 | 67,1 | 49,3 | 66,3 | 91,8 |
| Outside diameter of anchor | d_{nom} | [mm] | 8 | | 10 | | | 14 | | | |

¹⁾ Parameters relevant only for design according to CEN/TS 1992-4:2009.

²⁾ Parameter relevant only for design according to ETAG001 Annex C

Hilti Screw anchor HUS3

Performances

Characteristic values for static and quasi-static action

Annex C3

Table C3: Characteristic values for seismic category C1

| Anchor size HUS3 | | 8 | | 10 | | 14 | |
|---|------------------------|-------------------|-------------------|-------------------|---------------------|-------------------|-------------------|
| Nominal embedment depth | h_{nom} [mm] | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ |
| Steel failure for tension and shear load | | | | | | | |
| Characteristic resistance | $N_{Rk,s,\text{seis}}$ | [kN] | 39,2 | | 62,2 | | 96,6 |
| Partial safety factor | $\gamma_{Ms,N}$ | [-] | 1,4 | | | | |
| Characteristic resistance | $V_{Rk,s,\text{seis}}$ | [kN] | 11,9 | | 16,8 | 17,7 | 22,5 |
| Partial safety factor | $\gamma_{Ms,V}$ | [-] | 1,5 | | | | |
| Pull-out failure | | | | | | | |
| Characteristic resistance in cracked concrete | $N_{Rk,p,\text{seis}}$ | [kN] | 9 | 12 | 1) | 1) | 1) |
| Concrete cone failure | | | | | | | |
| Effective embedment depth | h_{ef} | [mm] | 46,4 | 54,9 | 58,6 | 67,1 | 66,3 |
| Concrete cone failure | Edge distance | $c_{cr,N}$ | [mm] | | 1,5 h_{ef} | | |
| | Spacing | $s_{cr,N}$ | [mm] | | 3 h_{ef} | | |
| Installation safety factor | γ_2 | [-] | | | 1,0 | | |
| Concrete pry-out failure | | | | | | | |
| k factor | k | [-] | | | 2,0 | | |
| Concrete edge failure | | | | | | | |
| Effective length of anchor | $l_f = h_{\text{ef}}$ | [-] | 46,4 | 54,9 | 58,6 | 67,1 | 66,3 |
| Outside diameter of anchor | d_{nom} | [mm] | 8 | | 10 | | 14 |

¹⁾ Pull-out failure is not decisive

Hilti Screw anchor HUS3

Performances

Characteristic values for seismic performance category C1

Annex C4

Table C4: Characteristic values for seismic category C2

| Anchor size HUS3 | | 10 h_{nom3} | 14 h_{nom3} | | | |
|---|------------------------|-------------------------|-------------------------|------|--|--|
| Nominal embedment depth | h_{nom} | [mm] | 85 | 115 | | |
| Adjustment | | | | | | |
| Total max. thickness of adjustment layers | t_{adj} | [mm] | 10 | - | | |
| Max. number of adjustments | n_a | [\cdot] | 2 | - | | |
| Steel failure for tension load | | | | | | |
| Characteristic resistance | $N_{Rk,s,\text{seis}}$ | [kN] | 62,2 | 96,6 | | |
| Partial safety factor | $\gamma_{Ms,N}$ | [\cdot] | 1,4 | | | |
| Pull out failure | | | | | | |
| Characteristic resistance in cracked concrete | $N_{Rk,p,\text{seis}}$ | [kN] | 9,4 | 17,7 | | |
| Concrete cone failure | | | | | | |
| Effective embedment depth | h_{ef} | [mm] | 67,1 | 91,8 | | |
| Concrete cone failure | $c_{cr,N}$ | [mm] | 1,5 h_{ef} | | | |
| Spacing | $s_{cr,N}$ | [mm] | 3 h_{ef} | | | |
| Installation safety factor | γ_2 | [\cdot] | 1,0 | | | |
| Steel failure for shear load | | | | | | |
| Installation with Hilti filling set | | | | | | |
| Characteristic resistance | $V_{Rk,s,\text{seis}}$ | [kN] | 25,6 | 46,5 | | |
| Partial safety factor | $\gamma_{Ms,V}$ | [\cdot] | 1,5 | | | |
| Installation without Hilti filling set | | | | | | |
| Characteristic resistance | $V_{Rk,s,\text{seis}}$ | [kN] | 17,7 | 34,4 | | |
| Partial safety factor | $\gamma_{Ms,V}$ | [\cdot] | 1,5 | | | |
| Concrete pry-out failure | | | | | | |
| k factor | k | [\cdot] | 2,0 | | | |
| Concrete edge failure | | | | | | |
| Effective length of anchor | $l_f = h_{\text{ef}}$ | [\cdot] | 67,1 | 91,8 | | |
| Outside diameter of anchor | d_{nom} | [mm] | 8 | 10 | | |

Hilti Screw anchor HUS3

Performances

Characteristic values for seismic performance category C2

Annex C5

Table C5: Characteristic values for resistance to Fire

| Anchor HUS3 | | 6 | | | | | | | | | |
|---|-----------------------|----------------------|-----|---------------|-------------|---|----|--|--|--|--|
| Type | | H | C | A | I I-Flex | P | PS | | | | |
| Nominal embedment depth | h_{nom} [mm] | 55 | | | | | | | | | |
| Steel failure for tension and shear load ($F_{Rk,s,fi} = N_{Rk,s,fi} = V_{Rk,s,fi}$) | | | | | | | | | | | |
| Characteristic resistance | R30 | $F_{Rk,s,fi}$ [kN] | | 1,6 | | | | | | | |
| | R60 | $F_{Rk,s,fi}$ [kN] | | 1,2 | | | | | | | |
| | R90 | $F_{Rk,s,fi}$ [kN] | | 0,8 | | | | | | | |
| | R120 | $F_{Rk,s,fi}$ [kN] | | 0,7 | | | | | | | |
| | R30 | $M^0_{Rk,s,fi}$ [Nm] | | 1,4 | | | | | | | |
| | R60 | $M^0_{Rk,s,fi}$ [Nm] | | 1,1 | | | | | | | |
| | R90 | $M^0_{Rk,s,fi}$ [Nm] | | 0,7 | | | | | | | |
| | R120 | $M^0_{Rk,s,fi}$ [Nm] | | 0,6 | | | | | | | |
| Pull-out failure | | | | | | | | | | | |
| Characteristic resistance | R30 | | | 1,5 | | | | | | | |
| | R60 | $N_{Rk,p,fi}$ [kN] | | | | | | | | | |
| Characteristic resistance | R90 | | | | | | | | | | |
| | R120 | $N_{Rk,p,fi}$ [kN] | | 1,2 | | | | | | | |
| Concrete cone failure | | | | | | | | | | | |
| R30 | | | 1,8 | | | | | | | | |
| Characteristic resistance | R60 | $N^0_{Rk,c,fi}$ [kN] | | | | | | | | | |
| | R90 | | | | | | | | | | |
| Characteristic resistance | R120 | $N^0_{Rk,c,fi}$ [kN] | | 1,5 | | | | | | | |
| | | | | | | | | | | | |
| Edge distance | | | | | | | | | | | |
| R30 to R120 | | $c_{cr,fi}$ [mm] | | 2 h_{ef} | | | | | | | |
| In case of fire attack from more than one side, the minimum edge distance shall be ≥ 300 mm. | | | | | | | | | | | |
| Anchor spacing | | | | | | | | | | | |
| R30 to R120 | | $s_{cr,fi}$ [mm] | | 2 $c_{cr,fi}$ | | | | | | | |
| Concrete pry-out failure | | | | | | | | | | | |
| R30 to R120 | | k [-] | | 1,5 | | | | | | | |
| The anchorage depth has to be increased for wet concrete by at least 30 mm compared to the given value. | | | | | | | | | | | |

Hilti Screw anchor HUS3

Performances

Characteristic values for resistance to fire

Annex C6

Table C6: Characteristic values for resistance to Fire

| Anchor HUS3-H and HUS3-HF | | | 8 | | | 10 | | | 14 | | | | | | | | | | |
|---|------------------|-----------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|-------------------|--|--|--|--|--|--|--|--|
| Nominal embedment depth | h_{nom} | [mm] | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | | | | | | | | |
| Steel failure for tension and shear load ($F_{Rk,s,fi} = N_{Rk,s,fi} = V_{Rk,s,fi}$) | | | | | | | | | | | | | | | | | | | |
| Characteristic resistance | R30 | $F_{Rk,s,fi}$ | [kN] | 3,2 | 3,5 | 3,8 | 6,1 | 6,2 | 10,4 | 10,6 | | | | | | | | | |
| | R60 | $F_{Rk,s,fi}$ | [kN] | 2,4 | 2,6 | 2,8 | 4,6 | 4,7 | 7,8 | 8,1 | | | | | | | | | |
| | R90 | $F_{Rk,s,fi}$ | [kN] | 1,6 | 1,6 | 1,9 | 3,1 | 3,2 | 5,3 | 5,5 | | | | | | | | | |
| | R120 | $F_{Rk,s,fi}$ | [kN] | 1,2 | 1,2 | 1,5 | 2,4 | 2,5 | 4,0 | 4,3 | | | | | | | | | |
| | R30 | $M_{Rk,s,fi}^0$ | [Nm] | 3,8 | 4,1 | 4,4 | 9,1 | 9,2 | 20,4 | 20,6 | | | | | | | | | |
| | R60 | $M_{Rk,s,fi}^0$ | [Nm] | 2,8 | 3,0 | 3,4 | 6,9 | 7,0 | 15,4 | 15,7 | | | | | | | | | |
| | R90 | $M_{Rk,s,fi}^0$ | [Nm] | 1,9 | 1,9 | 2,3 | 4,6 | 4,8 | 10,4 | 10,7 | | | | | | | | | |
| | R120 | $M_{Rk,s,fi}^0$ | [Nm] | 1,5 | 1,4 | 1,7 | 3,5 | 3,7 | 7,9 | 8,3 | | | | | | | | | |
| Pull-out failure | | | | | | | | | | | | | | | | | | | |
| Characteristic resistance | R30 | $N_{Rk,p,fi}$ | [kN] | 1,5 | 2,3 | 3,0 | 2,4 | 4,0 | 4,9 | 3,1 | 4,8 | | | | | | | | |
| | R60 | $N_{Rk,p,fi}$ | [kN] | 1,2 | 1,8 | 2,4 | 1,9 | 3,2 | 3,9 | 2,5 | 3,8 | | | | | | | | |
| Characteristic resistance | R90 | $N_{Rk,p,fi}$ | [kN] | 1,2 | 1,8 | 2,4 | 1,9 | 3,2 | 3,9 | 2,5 | 3,8 | | | | | | | | |
| | R120 | $N_{Rk,p,fi}$ | [kN] | 1,2 | 1,8 | 2,4 | 1,9 | 3,2 | 3,9 | 2,5 | 3,8 | | | | | | | | |
| Concrete cone failure | | | | | | | | | | | | | | | | | | | |
| Characteristic resistance | R30 | $N_{Rk,c,fi}^0$ | [kN] | 1,8 | 2,6 | 4,0 | 2,0 | 4,7 | 6,6 | 3,0 | 6,4 | | | | | | | | |
| | R60 | $N_{Rk,c,fi}^0$ | [kN] | 1,4 | 2,1 | 3,2 | 1,6 | 3,8 | 5,3 | 2,4 | 5,1 | | | | | | | | |
| Characteristic resistance | R90 | $N_{Rk,c,fi}^0$ | [kN] | 1,4 | 2,1 | 3,2 | 1,6 | 3,8 | 5,3 | 2,4 | 5,1 | | | | | | | | |
| | R120 | $N_{Rk,c,fi}^0$ | [kN] | 1,4 | 2,1 | 3,2 | 1,6 | 3,8 | 5,3 | 2,4 | 5,1 | | | | | | | | |
| Edge distance | | | | | | | | | | | | | | | | | | | |
| R30 to R120 | | $c_{cr,fi}$ | [mm] | $2 h_{ef}$ | | | | | | | | | | | | | | | |
| In case of fire attack from more than one side, the minimum edge distance shall be ≥ 300 mm. | | | | | | | | | | | | | | | | | | | |
| Anchor spacing | | | | | | | | | | | | | | | | | | | |
| R30 to R120 | | $s_{cr,fi}$ | [mm] | $2 c_{cr,fi}$ | | | | | | | | | | | | | | | |
| Concrete pry-out failure | | | | | | | | | | | | | | | | | | | |
| R30 to R120 | | k | [-] | 1,0 | 2,0 | 1,0 | 2,0 | | | | | | | | | | | | |
| The anchorage depth has to be increased for wet concrete by at least 30 mm compared to the given value. | | | | | | | | | | | | | | | | | | | |

Hilti Screw anchor HUS3

Performances

Characteristic values for resistance to fire

Annex C7

Table C7: Characteristic values for resistance to Fire

| Anchor HUS3-C | | | 8 | | | 10 | | | | | | | |
|---|------|----------------------|-----------------------|-------------------|-------------------|-------------------|-------------------|-------------------|--|--|--|--|--|
| | | | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | $h_{\text{nom}1}$ | $h_{\text{nom}2}$ | $h_{\text{nom}3}$ | | | | | |
| Nominal embedment depth | | | h_{nom} [mm] | 50 | 60 | 70 | 55 | 75 | | | | | |
| Steel failure for tension and shear load ($F_{Rk,s,fi} = N_{Rk,s,fi} = V_{Rk,s,fi}$) | | | | | | | | | | | | | |
| Characteristic resistance | R30 | $F_{Rk,s,fi}$ [kN] | 0,5 | | | | 1,2 | | | | | | |
| | R60 | $F_{Rk,s,fi}$ [kN] | 0,4 | | | | 1,0 | | | | | | |
| | R90 | $F_{Rk,s,fi}$ [kN] | 0,3 | | | | 0,8 | | | | | | |
| | R120 | $F_{Rk,s,fi}$ [kN] | 0,2 | | | | 0,6 | | | | | | |
| | R30 | $M_{Rk,s,fi}^0$ [Nm] | 0,6 | | | | 1,7 | | | | | | |
| | R60 | $M_{Rk,s,fi}^0$ [Nm] | 0,5 | | | | 1,5 | | | | | | |
| | R90 | $M_{Rk,s,fi}^0$ [Nm] | 0,4 | | | | 1,1 | | | | | | |
| | R120 | $M_{Rk,s,fi}^0$ [Nm] | 0,3 | | | | 0,9 | | | | | | |
| Pull-out failure | | | | | | | | | | | | | |
| Characteristic resistance | R30 | | | | | | | | | | | | |
| | R60 | $N_{Rk,p,fi}$ [kN] | 1,5 | 2,3 | 3,0 | 2,4 | 4,0 | 5,0 | | | | | |
| | R90 | | | | | | | | | | | | |
| | R120 | $N_{Rk,p,fi}$ [kN] | 1,2 | 1,8 | 2,4 | 1,9 | 3,2 | 4,0 | | | | | |
| Concrete cone failure | | | | | | | | | | | | | |
| Characteristic resistance | R30 | | | | | | | | | | | | |
| | R60 | $N_{Rk,c,fi}^0$ [kN] | 1,8 | 2,6 | 4,0 | 2,0 | 4,7 | 6,6 | | | | | |
| | R90 | | | | | | | | | | | | |
| | R120 | $N_{Rk,c,fi}^0$ [kN] | 1,5 | 2,1 | 3,2 | 1,6 | 3,8 | 5,3 | | | | | |
| Edge distance | | | | | | | | | | | | | |
| R30 to R120 | | | $c_{cr,fi}$ [mm] | 2 h_{ef} | | | | | | | | | |
| In case of fire attack from more than one side, the minimum edge distance shall be ≥ 300 mm. | | | | | | | | | | | | | |
| Anchor spacing | | | | | | | | | | | | | |
| R30 to R120 | | | $s_{cr,fi}$ [mm] | 2 $c_{cr,fi}$ | | | | | | | | | |
| Concrete pry-out failure | | | | | | | | | | | | | |
| R30 to R120 | | | k [-] | 1,0 | 2,0 | 1,0 | 2,0 | | | | | | |
| The anchorage depth has to be increased for wet concrete by at least 30 mm compared to the given value. | | | | | | | | | | | | | |

Hilti Screw anchor HUS3

Performances

Characteristic values for resistance to fire

Annex C8

Table C8: Displacements under tension load HUS3-6

| Anchor size HUS3 | | | 6 | |
|---------------------------------------|--------------|--------------------|------------|-------|
| Type | | | H, C, A. I | P, PS |
| Nominal embedment depth | | | 55 | |
| Cracked concrete C20/25 to C50/60 | Tension Load | N | [kN] | 2,4 |
| | | δ_{N0} | [mm] | 0,1 |
| | Displacement | $\delta_{N\infty}$ | [mm] | 0,6 |
| | | $\delta_{N,seis}$ | [mm] | - |
| Non-cracked concrete C20/25 to C50/60 | Tension Load | N | [kN] | 3,6 |
| | | δ_{N0} | [mm] | 0,2 |
| | Displacement | $\delta_{N\infty}$ | [mm] | 0,3 |
| | | | | |

Table C9: Displacements under tension load HUS3-8, 10, 14

| Anchor size HUS3 | | | 8 | | | 10 | | | 14 | | |
|---------------------------------------|--------------|--------------------|------------|------------|------------|------------|------------|------------|------------|------------|------------|
| | | | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} |
| Nominal embedment depth | | | 50 | 60 | 70 | 55 | 75 | 85 | 65 | 85 | 115 |
| Cracked concrete C20/25 to C50/60 | Tension Load | N | [kN] | 4,3 | 5,7 | 7,6 | 5,7 | 9,5 | 13,2 | 8,3 | 13,0 |
| | | δ_{N0} | [mm] | 0,3 | 0,4 | 0,3 | 0,4 | 0,4 | 0,4 | 0,6 | 0,5 |
| | Displacement | $\delta_{N\infty}$ | [mm] | 0,7 | 0,7 | 0,6 | 0,4 | 0,4 | 0,5 | 0,9 | 1,2 |
| | | $\delta_{N,seis}$ | [mm] | - | - | 0,6 | - | - | 0,9 | - | 1,3 |
| Non-cracked concrete C20/25 to C50/60 | Tension Load | N | [kN] | 6,6 | 8,9 | 11,8 | 8,7 | 14,8 | 20,5 | 12,9 | 20,1 |
| | | δ_{N0} | [mm] | 0,1 | 0,2 | 0,1 | 0,1 | 0,1 | 0,1 | 0,1 | 0,3 |
| | Displacement | $\delta_{N\infty}$ | [mm] | 0,3 | | | 0,2 | | | 0,5 | |
| | | | | | | | | | | | |

Table C10: Displacements under shear load HUS3-6, 8, 10 and 14

| Anchor size HUS3 | | | 6 | 8 | | | 10 | | | 14 | | |
|-----------------------------------|--------------|--------------------|-----------|------------|------------|------------|------------|------------|------------|------------|------------|------------|
| | | | h_{nom} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} | h_{nom1} | h_{nom2} | h_{nom3} |
| Nominal embedment depth | | | 55 | 50 | 60 | 70 | 55 | 75 | 85 | 65 | 85 | 115 |
| Cracked concrete C20/25 to C50/60 | Shear Load | V | [kN] | 6,0 | 8,1 | | | 13,3 | | | 21,4 | |
| | | δ_{V0} | [mm] | 1,9 | 2,5 | 3,4 | 2,9 | 3,8 | 3,7 | 3,2 | 3,6 | 3,2 |
| | Displacement | $\delta_{V\infty}$ | [mm] | 2,8 | 3,7 | 5,1 | 4,4 | 5,7 | 5,5 | 4,9 | 5,4 | 6,9 |
| | | $\delta_{V,seis}$ | [mm] | - | - | - | 0,6 | - | - | 0,9 | - | 1,3 |

Hilti Screw anchor HUS3

Performances

Displacements values for static and quasi-static action

Annex C9

Table C11: Displacements under tension load for HUS3 for seismic performance category C2

| Anchor size HUS3 | 10 | 14 |
|---|------------|------------|
| Nominal embedment depth | h_{nom3} | h_{nom3} |
| Displacement DLS $\delta_{N,seis}(DLS)$ | [mm] | 0,57 |
| Displacement ULS $\delta_{N,seis}(ULS)$ | [mm] | 2,08 |
| | | 1,43 |
| | | 4,32 |

Table C12: Displacements under shear load for HUS3 for seismic performance category C2

| Anchor size HUS3 | 10 | 14 |
|---|------------|------------|
| Nominal embedment depth | h_{nom3} | h_{nom3} |
| Installation with Hilti filling set | | |
| Displacement DLS $\delta_{V,seis}(DLS)$ | [mm] | 1,80 |
| Displacement ULS $\delta_{V,seis}(ULS)$ | [mm] | 4,03 |
| Installation without Hilti filling set | | |
| Displacement DLS $\delta_{V,seis}(DLS)$ | [mm] | 4,15 |
| Displacement ULS $\delta_{V,seis}(ULS)$ | [mm] | 6,15 |
| | | 2,52 |
| | | 6,79 |
| | | 4,93 |
| | | 9,14 |

Hilti Screw anchor HUS3

Performances

Displacements values for seismic category C2

Annex C10